

# NARF ACCESSIBILITY SURVEY FORM J: ROOMS AND AREAS

Building Identification: \_\_\_\_\_

Room/Area Location: \_\_\_\_\_

1.	YES	NO	N/A	Do the doors comply with 4.13? (Refer to Survey Form J to determine.) (4.13)
2.	YES	NO	N/A	Are aisles at least 36 inches wide, excluding doorways? (4.3.3)
3.	YES	NO	N/A	Where the accessible pathway makes a U-turn around an obstacle which is less than 48 inches wide, does the pathway width increase to at least 42 inches on the approach and 48 inches in the turn? (See Figure 7b)
4.	YES	NO	N/A	If the aisles are less than 60 inches wide, are there passing spaces at least 60 inches wide and 60 inches long within reasonable intervals not exceeding 200 feet? (4.3.4)
5.	YES	NO	N/A	Is there at least 80 inches clear head room in the accessible space? (4.35)
6.	YES	NO	N/A	If head room in part of an accessible space is less than 80 inches, is there a cane detectable barrier within 27 inches of the floor?
7.	YES	NO	N/A	If objects mounted to the wall have bottom edges between 27 and 80 inches from the floor, do they project less than 4 inches into the space? (Those with bottom edges lower than 27 inches may project any amount as long as they do not reduce the required clear width of an accessible travel route.) (4.4.1)
8.	YES	NO	N/A	Do freestanding objects mounted on posts with bottom edges between 27 and 80 inches project less than 12 inches into the route of travel?
9.	YES	NO	N/A	Is there an accessible path of at least 36 inches clear beside the protruding object?
10.	YES	NO	N/A	Are the floors in all accessible rooms and areas stable, firm and slipresistant? (4.5-1)
11.	YES	NO	N/A	Is any level change greater than 1/2 (.50) inch ramped? (4.3.8 & 4.5.2)
12.	YES	NO	N/A	Are level changes between 1/4 (2.5) and 1/2 (50) inch beveled with a slope no greater than 1:2?

13.	YES	NO	N/A	when floor materials change, does the vertical difference between them meet these provisions?
14.	YES	NO	N/A	If carpet or carpet tile is used on the floor, is it securely attached? (4.5.3)
15.	YES	NO	N/A	Is it a low pile carpet with a firm or no pad underneath?
16.	YES	NO	N/A	Is carpet pile 1/2 inch or less?

### *Signage*

17.	YES	NO	N/A	On room signs, do the letters and numbers have a width-to-height ratio between 3:5 and 1:1, and a stroke width-to-height ratio between 15 and 1:10? (4.1.3[16] & 4.30.2)
18.	YES	NO	N/A	Does the color of the characters and symbols contrast with the color of the background, and do the signs have an eggshell finish? (4.30.5)
19.	YES	NO	N/A	Do signs providing permanent identification of rooms and spaces have raised letters? (4.1.3[16] & 4.30.4)
20.	YES	NO	N/A	Are the characters upper case sans serif or simple serif?
21.	YES	NO	N/A	Are the characters and symbols on signs raised 1/32 inch?
22.	YES	NO	N/A	Are the raised characters or symbols between 5/8 inch and 2 inches in height?
23.	YES	NO	N/A	Are they mounted on the wall at the latch side of the door at 60 inches above the floor? (4.30.6)

### *Storage*

24.	YES	NO	N/A	Is there a clear floor space 30 inches by 48 inches at storage facilities which allows for either a forward or side approach in a wheelchair? (4.25.2 & 4.2.4)
25.	YES	NO	N/A	If a side approach is provided, is there storage space between 9 and 54 inches from the floor? (4.25.3 & 4.2.5)
26.	YES	NO	N/A	If a front approach is provided, is there storage space between 9 and 48 inches from the floor?
27.	YES	NO	N/A	Are clothes rods a maximum of 54 inches from the floor, or 48 inches if reach is more than 10 inches?
28.	YES	NO	N/A	Where passage is not required to accessible storage, does the door have at least 20 inches in clear opening width? (4.13.5)
29.	YES	NO	N/A	Is the hardware on the storage doors operable with one hand? (4.25.4 & 4.27.4)
30.	YES	NO	N/A	Is the hardware operable without tight grasping or pinching, or twisting of the wrist?

### *Seating, tables & work surfaces*

31.	YES	NO	N/A	Do 5% (at least 1) of the built-in or fixed seating tables and work surfaces meet the following requirements? (4.1.3[18])
32.	YES	NO	N/A	Do these seating spaces which are provided for people in wheelchairs have a 30 inches by 48 inches clear space which overlaps an accessible route? (4.32.2 & 4.2.4)
33.	YES	NO	N/A	Is no more than 19 inches of the 30 by 48 inches clear space measured under the table? (Fig. 45)
34.	YES	NO	N/A	Is the knee space at least 27 inches high, 30 inches wide and 19 inches deep? (Fig. 45) (4.32.3)
35.	YES	NO	N/A	Is the top of the table or work surface between 28 and 34 inches from the floor? (4.32.4)
36.	YES	NO	N/A	Are the aisles between tables at least 36 inches wide? (4.3.3)

### *Controls*

37.	YES	NO	N/A	Are light switches, thermostatic controls, electrical receptacles and similar devices between 15 and 54 inches from the floor when the clear floor space allows a parallel approach, <i>or</i> are they between 15 and 48 inches when the clear floor space allows only a front approach? (4.27.3)
-----	-----	----	-----	--

NOTES:

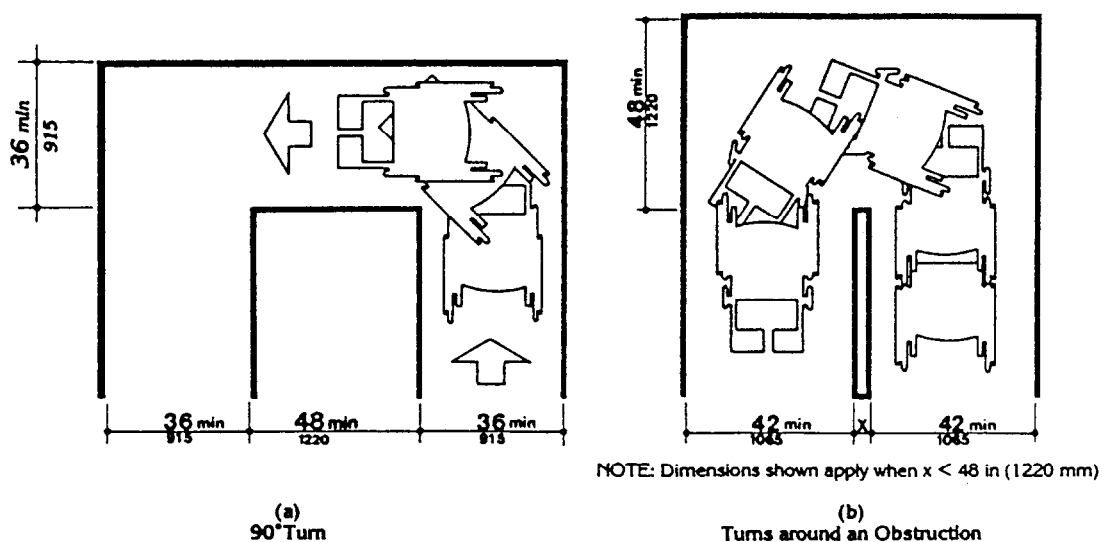


Fig. 7  
Width of Accessible Route

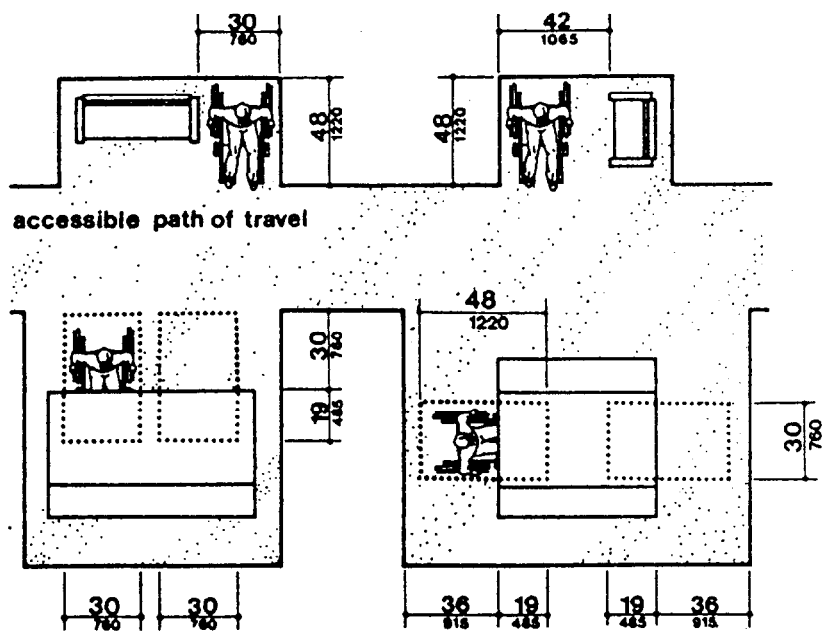


Fig. 45  
Minimum Clearances for Seating and Tables